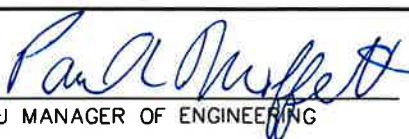


NOTES:

1. SERVICE CONNECTION SHALL BE PERPENDICULAR TO MAIN.
2. ADD DETECTOR TAPE TO ALL PIPE.
3. USE CLASS 50 DUCTILE IRON FOR SERVICES WITH LESS THAN 3' OF COVER.
4. NO SPLICES ON TRACER WIRE. MECHANICAL CONNECTORS ONLY IN CLEANOUTS.
5. EMBED PIPE IN #57 STONE FROM 6" BELOW INVERT TO 2" ABOVE CROWN.
6. INSTALLATION OF SEWER LATERAL INTO FOUNDATION PER TOWN OF EASTON STANDARD.
7. PROVIDE VIDEO INSPECTION OF LATERAL FROM CLEANOUT AT HOUSE/STRUCTURE, TO MAIN.

APPROVAL	REVISED	EASTON UTILITIES STANDARD DETAILS PVC SEWER HOUSE CONNECTION STANDARD NO. SS-8.02
 EU MANAGER OF ENGINEERING	JUN 11 ,97	
	MAR 1, 98	
	SEP 1, 09	
	JUL, 20, 11	
	SEP 15, 14	
ISSUED: JULY 1, 1996	JAN 15, 19	
JAN 15, 19 DATE		