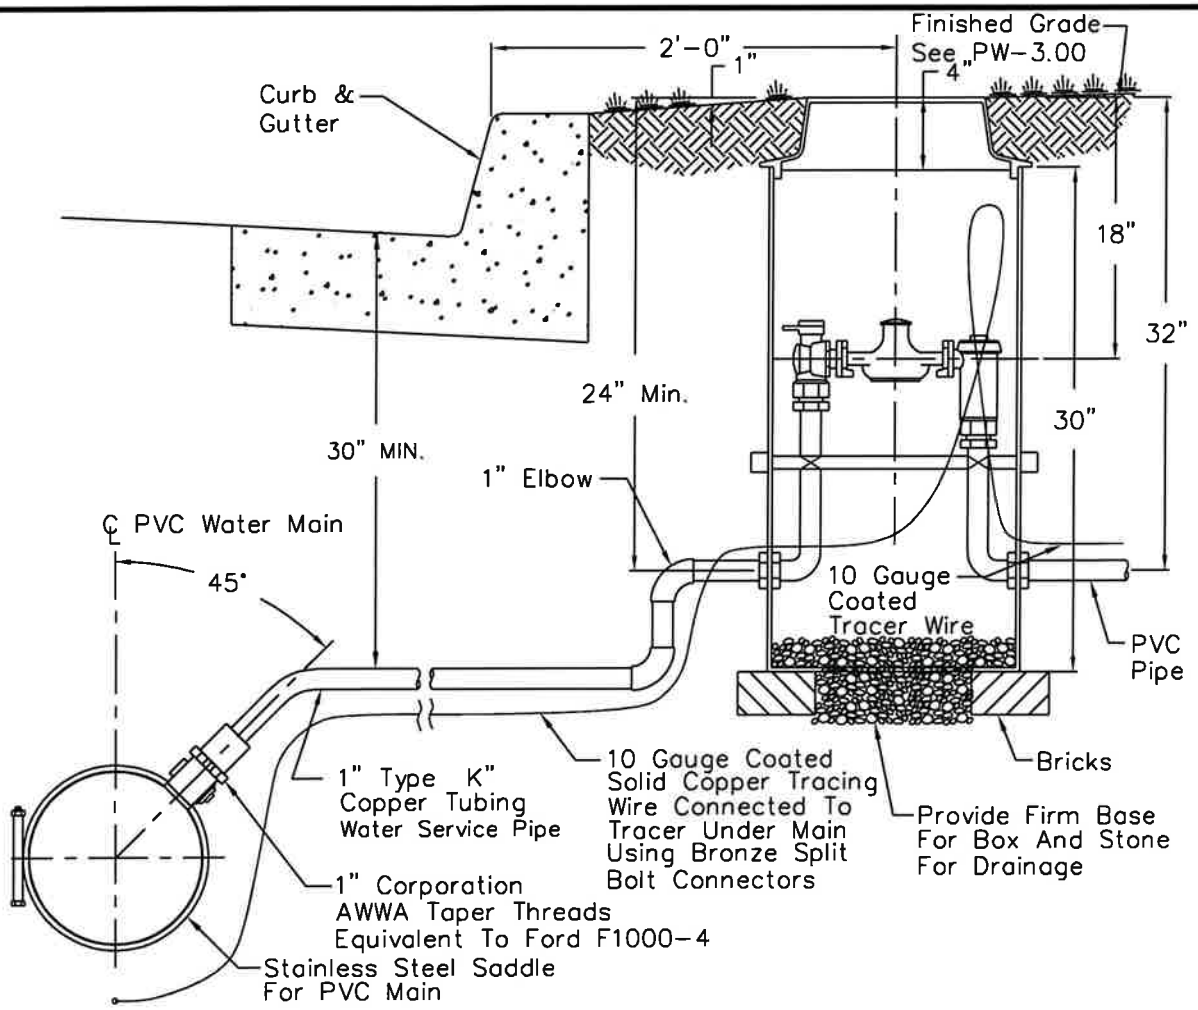


Notes:

1. Stainless Steel Saddle Shall Be Equivalent To Ford FS303 Or PowerSeal 3412AST.
2. PVC Main Shall Be Tapped With A Shell Type Cutter (Hole Cutter) That Will Retain The Coupon In Accordance With UNI-BELL Plastic Pipe Association UNI-B-3.
3. Meter Box (Ford No. PSBHC-488-20-36-18) Or An Approved Equal Furnished And Installed By Contractor. Cover Must Be Polymer Nicor 12.25PWATI Type A (Read -Rite) Lid With Water Logo, Worm Gear And Bracket For Itron 100W ERT Under Lid Or Equivalent. No Electronic Meter Reading Lid Hole.
4. Backfill And Tamp With Select Material To Pad Pipe. See Detail W-1.00.
5. 10 Gauge Coated Solid Copper Tracer Wire (Blue Jacket).
6. Thoroughly Tape Mechanical Connections With Electrical Tape.

| APPROVAL | REVISED | TOWN OF EASTON<br>AND<br>EASTON UTILITIES<br>STANDARD DETAILS<br>1" WATER SERVICE<br>INSTALLATION - PVC WATER MAIN |
|---|---|---|
| 3/18/19<br>EU MANAGER OF ENGINEERING DATE | MAR 9, 95<br>MAR 1, 98<br>SEP 1, 09<br>NOV 1, 10<br>JUL 20, 11 | |
| ISSUED: AUG 1, 1994 | MAR 18, 19 | STANDARD NO. W-7.02 |