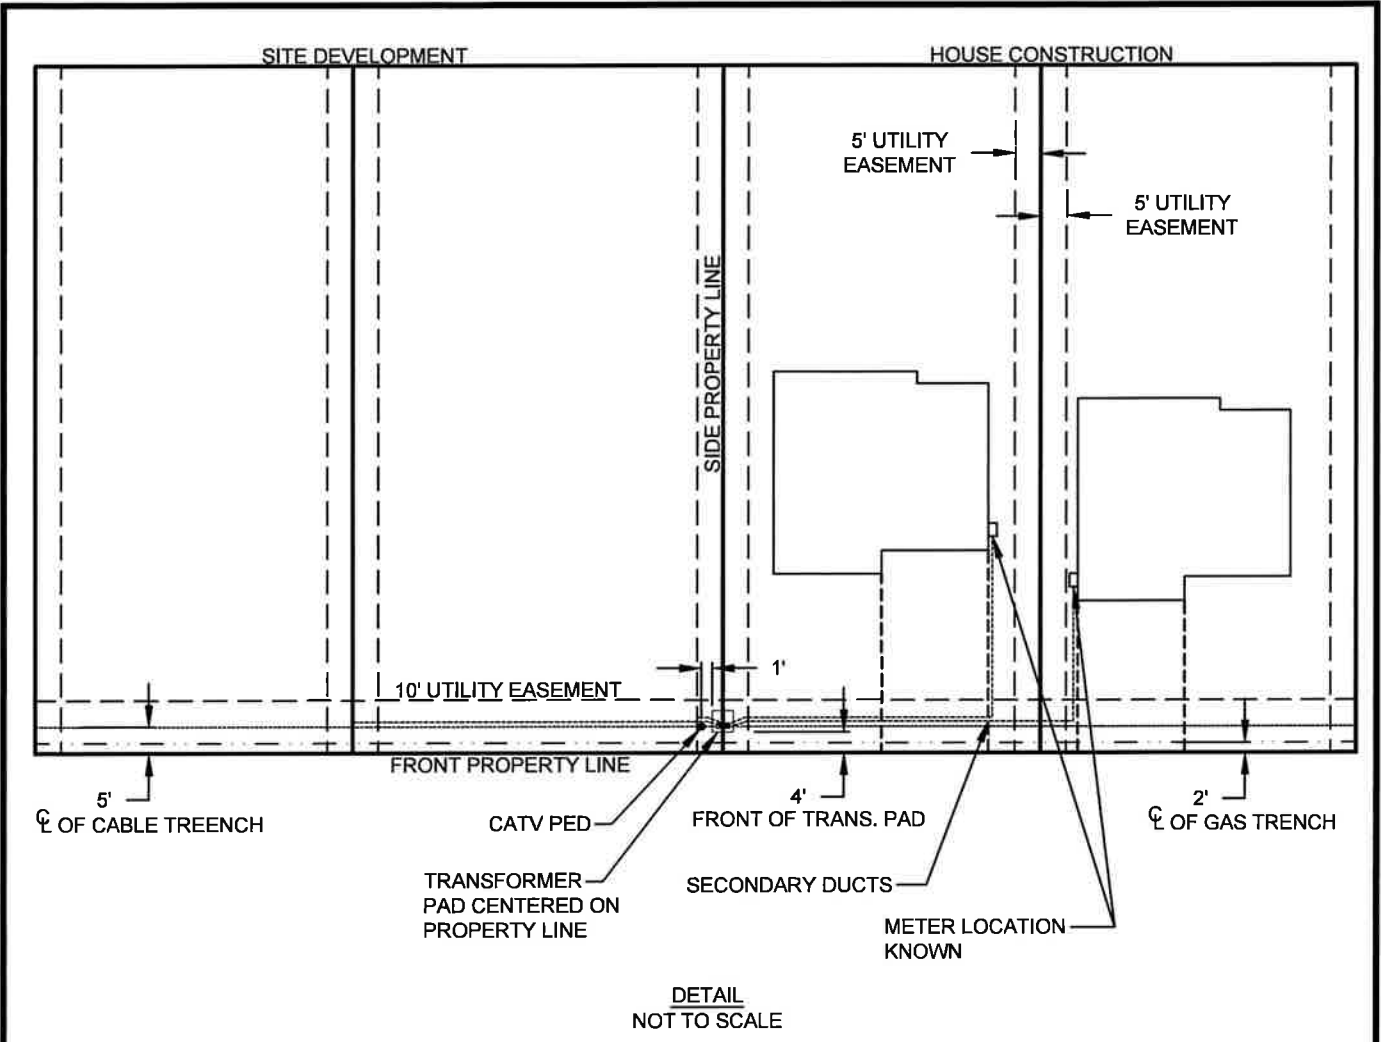




O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\E-100.3.dwg, 1/30/2024 3:26:54 PM, 1:1



NOTES:

1. ALL SECONDARY DUCTS NEED TO BE EXTENDED TO PROPERTY LINES OR PAST DRIVEWAYS IF LOCATION IS KNOWN. (METER SIDE OF HOUSE)
2. INSTALL DUCTS WITH 42" MIN. COVERAGE. TRENCH MUST BE INSPECTED BY EASTON UTILITIES PRIOR TO BACKFILLING.
3. REFER TO ELECTRIC PLAN DRAWINGS FOR CONDUIT SIZE REQUIREMENTS.
4. TRANSFORMER PAD SUPPLIED BY EASTON UTILITIES.
5. DEVELOPER/HOMEOWNER RESPONSIBLE FOR SECONDARY CONDUITS TO METER PAN DURING HOUSE CONSTRUCTION.
6. SEE CONDUIT AND DUCT BANK NOTES ON E-100.1.2 STANDARD DETAILS.

 Life. Made better.™	APPROVAL  EU ENGINEERING DEPARTMENT	REVISED	EASTON UTILITIES STANDARD DETAILS DUCT TRENCH LAYOUT TRANSFORMER PAD & CATV PED
	1/31/2024 DATE		
ISSUED: JANUARY 2024			STANDARD NO.: E-100.3