



O:\standets\REVISED 2024\E-101.1.2.dwg, 1/29/2024 10:42:32 AM, 1:1



TOP VIEW

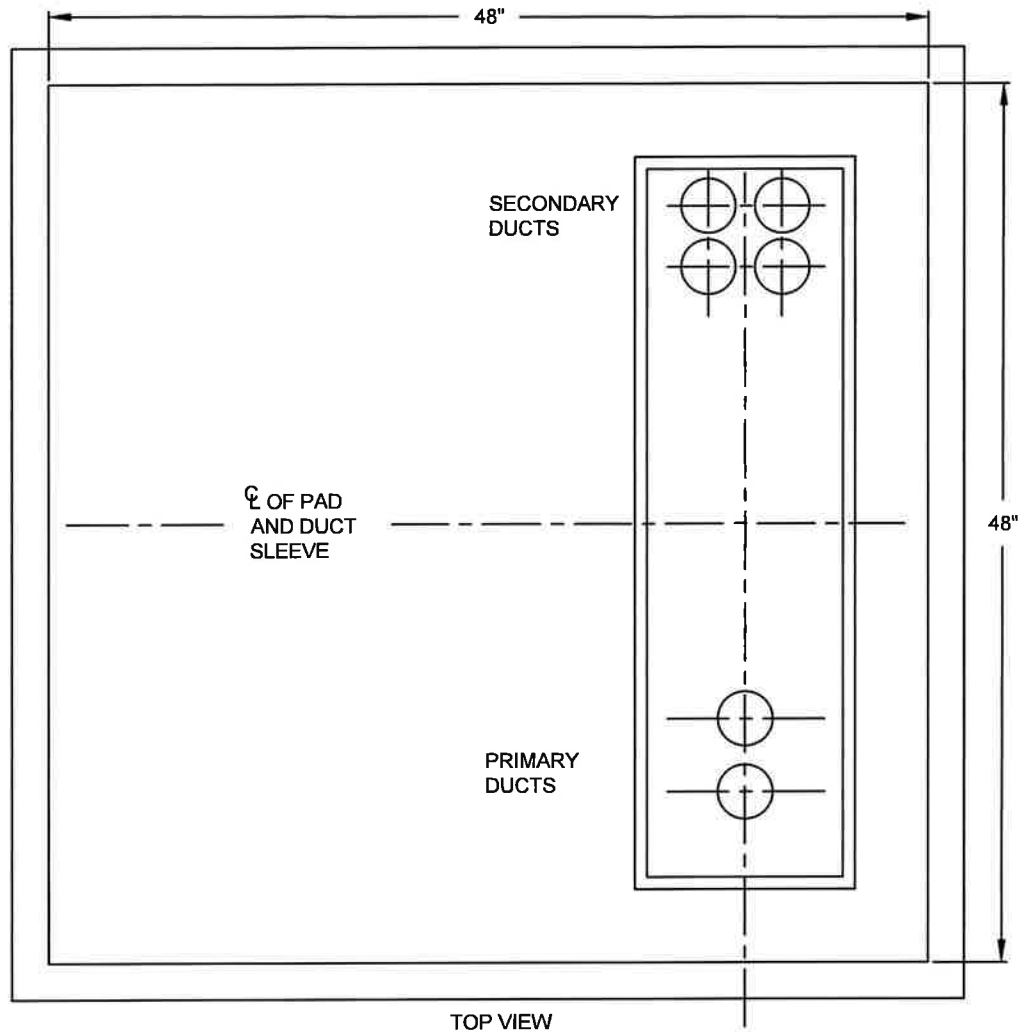

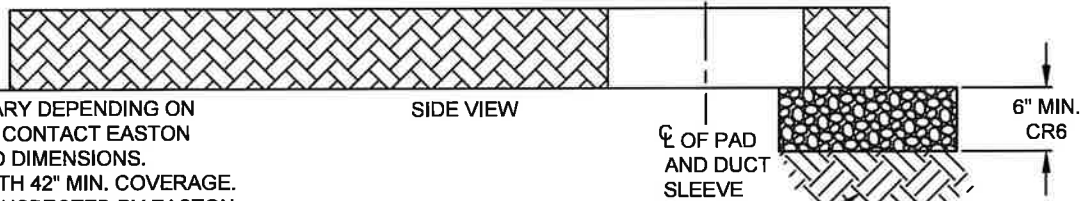

SIDE VIEW

**NOTES:**

1. PAD SIZES MAY VARY DEPENDING ON MANUFACTURER. CONTACT EASTON UTILITIES FOR PAD DIMENSIONS.
2. INSTALL DUCTS WITH 42" MIN. COVERAGE. TRENCH MUST BE INSPECTED BY EASTON UTILITIES PRIOR TO BACKFILLING.
3. REFER TO ELECTRIC PLAN DRAWINGS FOR PRIMARY AND SECONDARY CONDUIT SIZE AND QUANTITY.
4. MINIMUM OF 6" CR6 COMPACTED UNDER TRANSFORMER PAD.
5. COORDINATE WITH EASTON UTILITIES CONDUIT LOCATIONS WITHIN SLEEVE.

COMPACT SUBGRADE TO 95% MODIFIED PROCTOR AT 2% OPTIMUM MOISTURE CONTENT PER ASTM D1557.

 <p><b>Life. Made better.™</b></p>	<p><b>APPROVAL</b></p>  <p>EU ENGINEERING DEPARTMENT</p> <p><u>1/31/2024</u> DATE</p>	<p><b>REVISED</b></p>	<p><b>EASTON UTILITIES STANDARD DETAILS</b></p> <p><b>1Ø TRANSFORMER PAD 75 - 167 KVA (SUPPLIED BY EU)</b></p>
	<p><b>ISSUED: JANUARY 2024</b></p>		