


V:\Dwgs\Standard Details 2024\E-101.2.3.dwg Dec 17, 2025 - 9:51am, (Idennis)

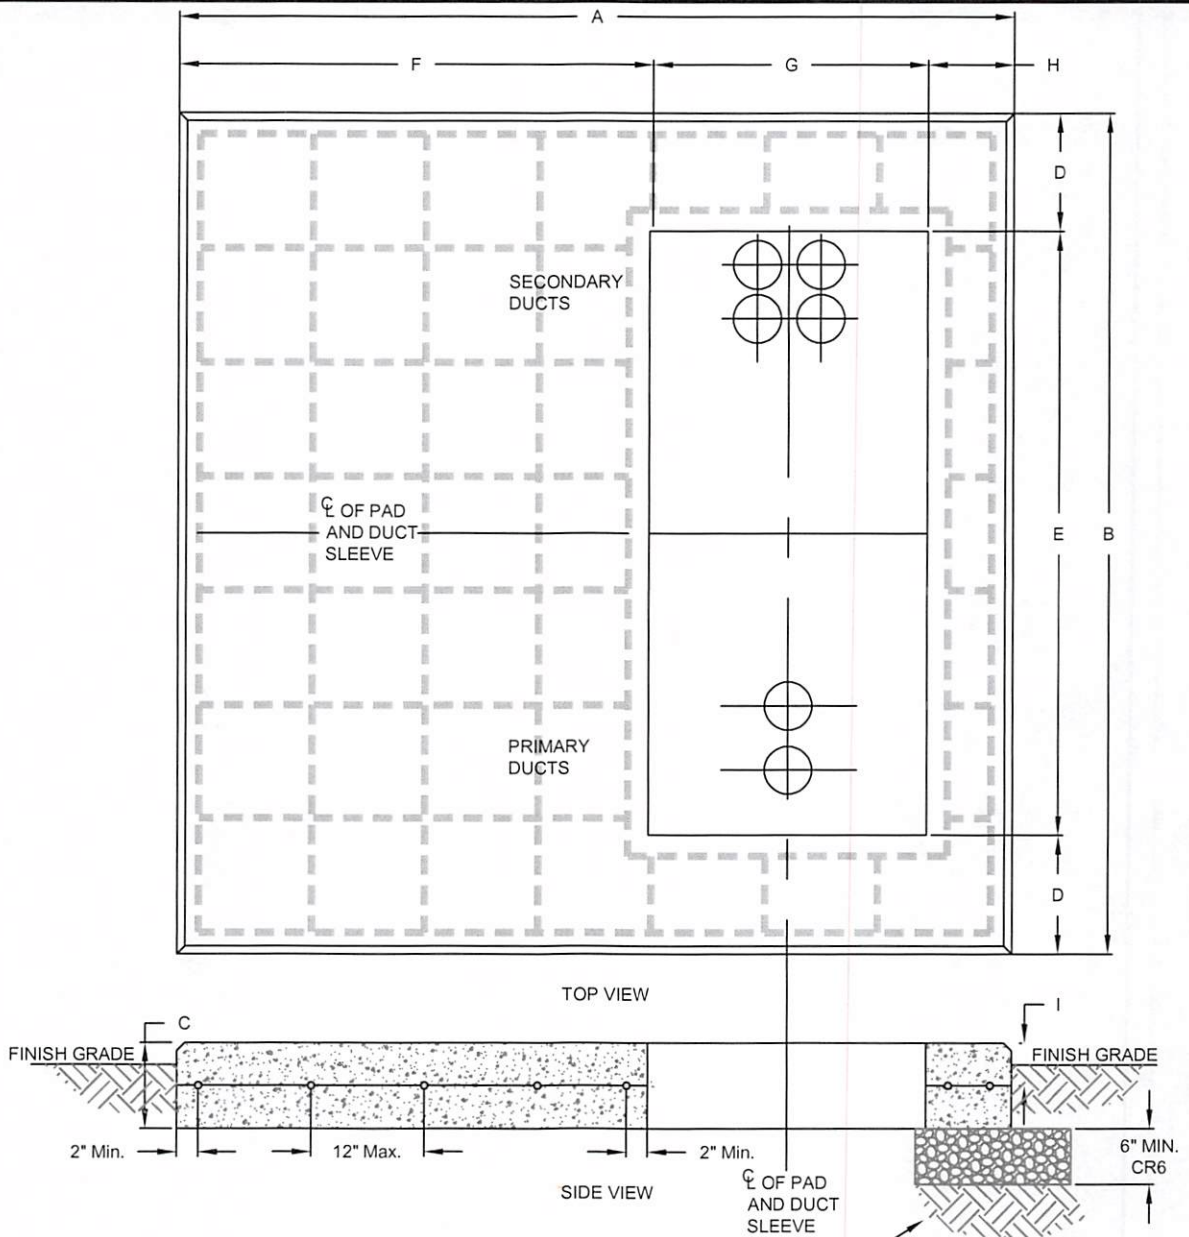

NOTES:

1. TRANSFORMER PAD TO SUPPORT WEIGHT UP TO 9000 LBS.
2. REFER TO ELECTRIC PLAN DRAWINGS FOR PRIMARY AND SECONDARY CONDUIT SIZE AND QUANTITY.
3. MINIMUM OF 6" CR6 COMPACTED UNDER TRANSFORMER PAD.
4. COORDINATE WITH EASTON UTILITIES CONDUIT LOCATIONS WITHIN SLEEVE.
5. MINIMUM 28 DAY ULTIMATE COMPRESSIVE STRENGTH OF NOT LESS THAN 3,000 PSI, PAD MUST BE CURED FOR MINIMUM OF 72 HOURS BEFORE EQUIPMENT IS INSTALLED.
6. REINFORCEMENT MUST BE #4 ASTM A615 REBAR WITH A MINIMUM GRADE OF 40. MAXIMUM OF 12" SPACING.
7. 3/4" CHAMFER REQUIRED ON ALL EXPOSED EDGES.
8. FLOAT CONCRETE TO ENSURE FLAT SURFACE, THEN BRUSH FINISH.
9. TOP OF CONCRETE PAD TO BE 2" ABOVE FINISHED GRADE.

KVA	A	B	C	D	E	F	G	H	I
75-150	78"	78"	8"	19"	40"	52"	16"	10"	4"
225-1000	92"	92"	8"	17"	58"	66"	16"	10"	4"



Life. Made better.™

APPROVAL

*[Signature]*  
EU ENGINEERING DEPARTMENT

*12/17/2025*  
DATE

REVISED

12/17/2025

EASTON UTILITIES  
STANDARD DETAILS

CONCRETE  
3Ø TRANSFORMER PAD  
75 - 1000 KVA

ISSUED: SEPT. 2025

STANDARD NO.: E-101.2.3