
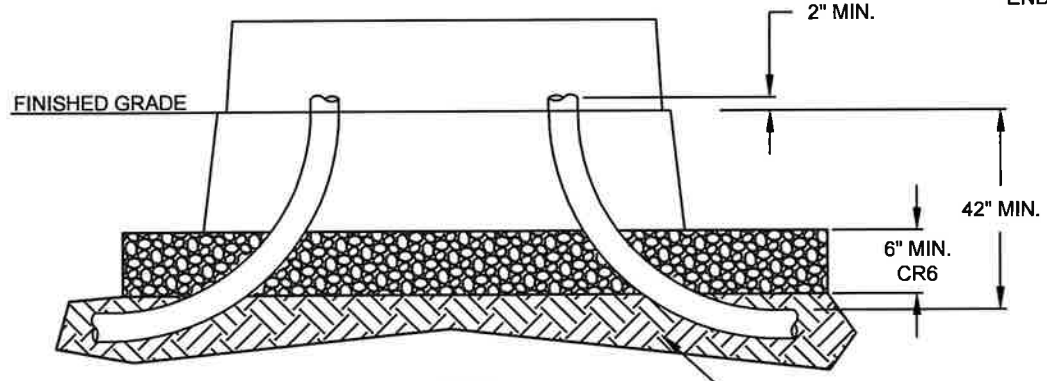


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\E-103.1.dwg, 1/30/2024 3:35:21 PM, 1:1

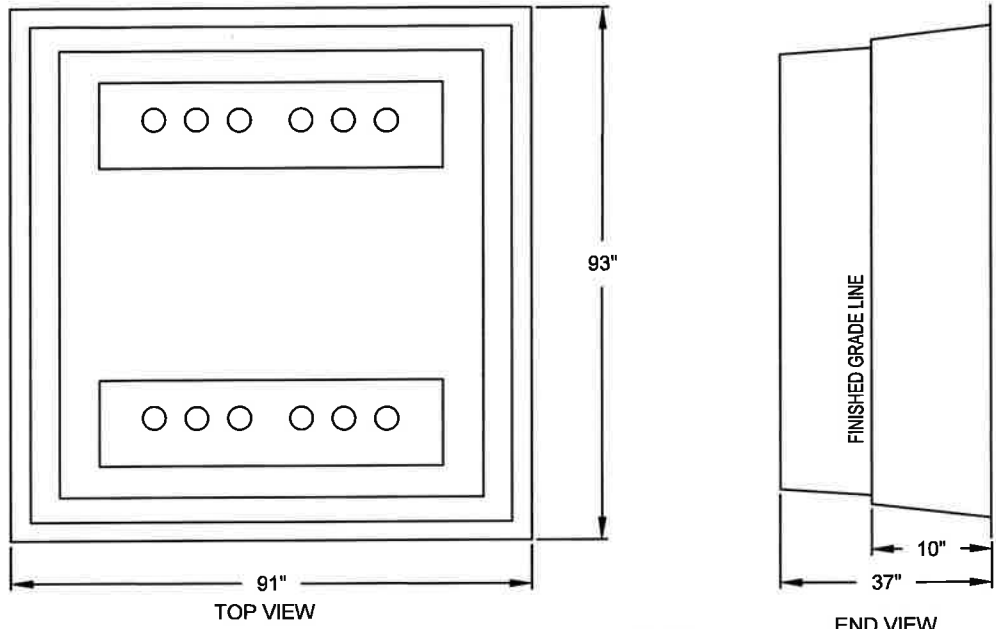

**NOTES:**


1. CABINET SIZES MAY VARY DEPENDING ON MANUFACTURER. CONTACT EASTON UTILITIES FOR CABINET DIMENSIONS.
2. INSTALL DUCTS WITH 42" MIN. COVERAGE. TRENCH MUST BE INSPECTED BY EASTON UTILITIES PRIOR TO BACKFILLING.
3. REFER TO ELECTRIC PLAN DRAWINGS FOR CONDUIT SIZE AND QUANTITY.
4. MINIMUM OF 6" CR6 COMPACTED UNDER TRANSFORMER PAD.
5. FIBERGLASS SLEEVE SUPPLIED BY EASTON UTILITIES.
6. COORDINATE WITH EASTON UTILITIES CONDUIT LOCATIONS WITHIN SLEEVE.
7. SEE CONDUIT AND DUCT BANK NOTES ON E-100.1.2 STANDARD DETAILS.

DETAIL  
NOT TO SCALE

COMPACT SUBGRADE TO 95% MODIFIED PROCTOR AT 2% OPTIMUM MOISTURE CONTENT PER ASTM D1557.



**Life. Made better.™**

	APPROVAL	REVISED	
	 EU ENGINEERING DEPARTMENT 1/31/2024 DATE		<b>EASTON UTILITIES STANDARD DETAILS</b>  <b>SWITCHING CABINET FIBERGLASS GROUND SLEEVE</b>
	<b>ISSUED: JANUARY 2024</b>		<b>STANDARD NO.: E-103.1</b>