



METER INSTALLATION SIDE VIEW
NOT TO SCALE

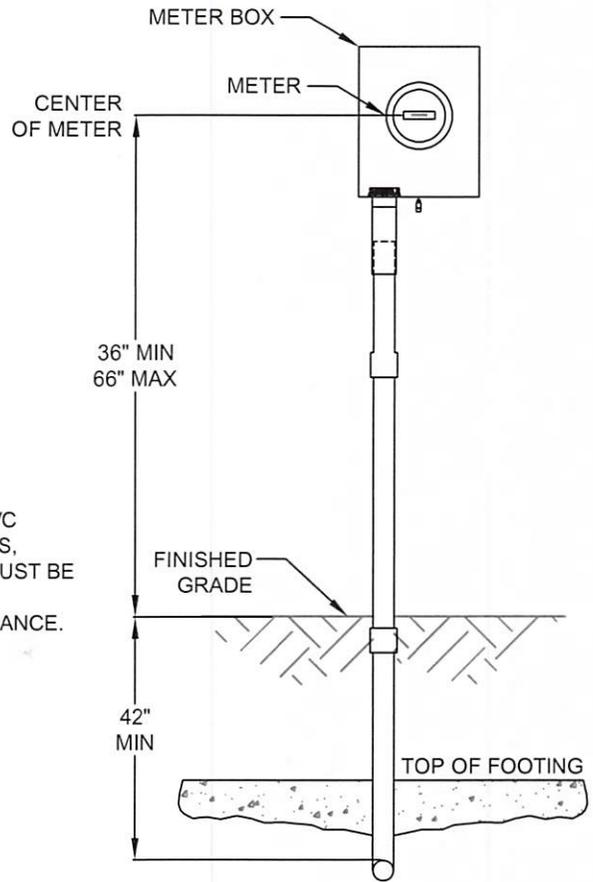

METER INSTALLATION FRONT VIEW
NOT TO SCALE

NOTE: IF PVC INTERFERES, FOOTING MUST BE NOTCHED FOR CLEARANCE.

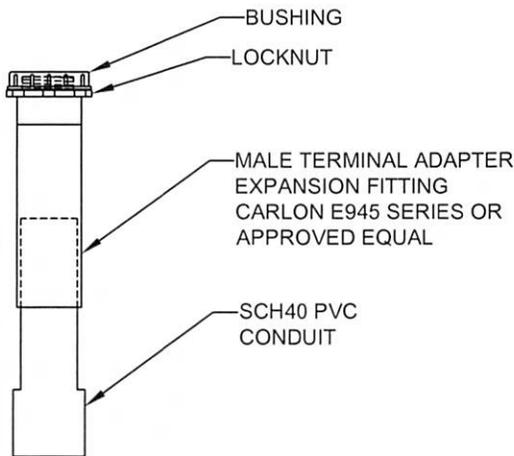

EXPANSION FITTING DETAIL
NOT TO SCALE

CONDUIT REQUIREMENTS

SERVICE SIZE	CONDUIT SIZE	QUANTITY
200A	2 1/2"	1
320A	3"	1

NOTES

1. SEE STANDARD DETAIL E-100.1.2 FOR CONDUIT SPECIFICATIONS.
2. FOR SERVICES LARGER THAN 320A SEE STD. DETAIL E-107.2.
3. METERING AND EQUIPMENT SHALL BE INSTALLED ON EXTERIOR OF BUILDING.
4. METER SHALL NOT BE OBSTRUCTED AND A THREE FOOT CLEARANCE MUST BE MAINTAINED FOR SAFETY.



Life. Made better.™

APPROVAL

[Signature]
EU ENGINEERING DEPARTMENT

3/11/2026
DATE

REVISED

MAR 2026

EASTON UTILITIES
STANDARD DETAILS

STANDARD METERING
DETAIL

ISSUED: APRIL 2025

STANDARD NO.: E-107.1