



METER INSTALLATION SIDE VIEW
NOT TO SCALE

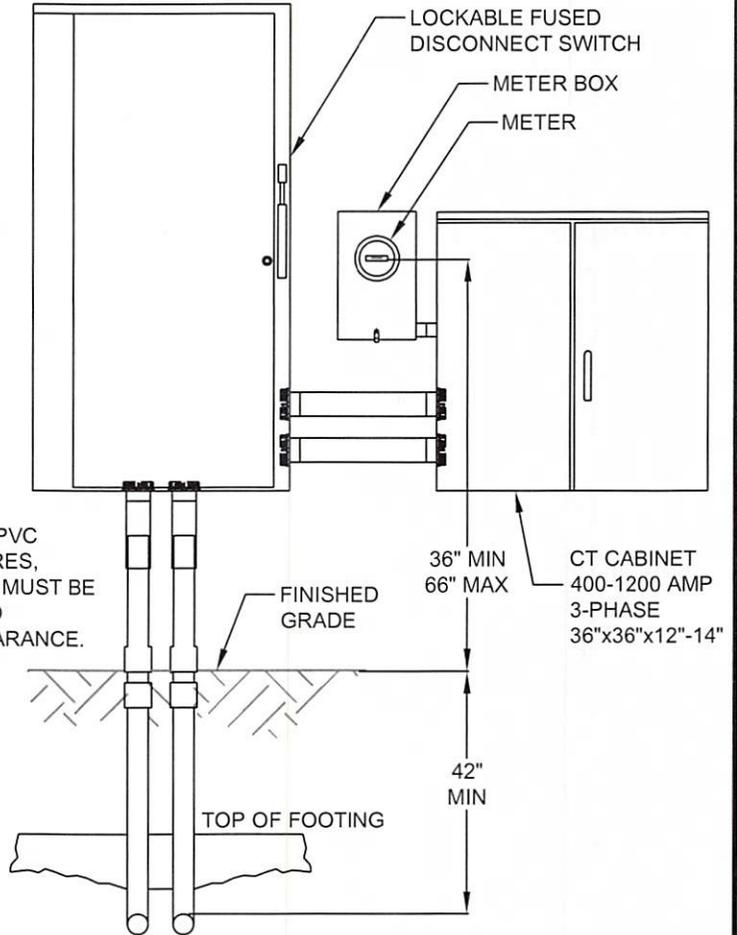

METER INSTALLATION FRONT VIEW
NOT TO SCALE

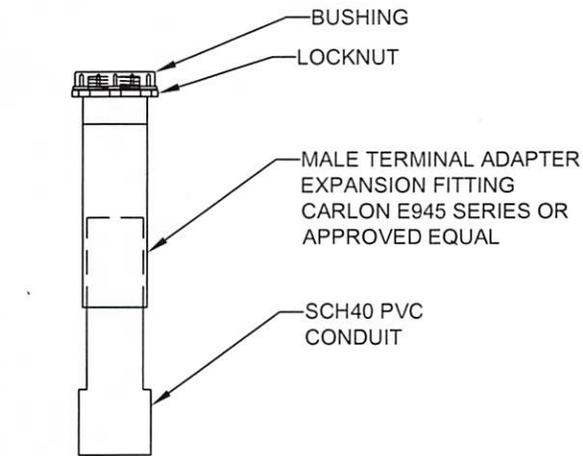

EXPANSION FITTING DETAIL
NOT TO SCALE

CONDUIT REQUIREMENTS

SERVICE SIZE	CONDUIT SIZE	QUANTITY
400A	4"	1
600A	4"	2
800A	4"	2
1200A	4"	3
1600A	4"	4
2000A	4"	6

NOTES

1. SEE STANDARD DETAIL E-100.1.2 FOR CONDUIT SPECIFICATIONS.
2. A SECOND LOCKABLE FUSED DISCONNECT SWITCH MAY BE ADDED.
3. METERING AND EQUIPMENT SHALL BE INSTALLED ON EXTERIOR OF BUILDING.
4. METER SHALL NOT BE OBSTRUCTED AND A TEN FOOT CLEARANCE MUST BE MAINTAINED FOR SAFETY.



Life. Made better.™

APPROVAL

[Signature]
EU ENGINEERING DEPARTMENT

3/11/2026
DATE

REVISED

MAR 2026

EASTON UTILITIES
STANDARD DETAILS

CT METERING
DETAIL

ISSUED: APRIL 2025

STANDARD NO.: E-107.2