

METER INSTALLATION FRONT VIEW
NOT TO SCALE


METER INSTALLATION SIDE VIEW
NOT TO SCALE

CONDUIT REQUIREMENTS

SERVICE SIZE	CONDUIT SIZE	QUANTITY
400A	4"	1
600A	4"	2
800A	4"	2
1200A	4"	3
1600A	4"	4
2000A	4"	6

NOTES

1. SEE STANDARD DETAIL E-100.1.2 FOR CONDUIT SPECIFICATIONS.
2. METERING AND EQUIPMENT SHALL BE INSTALLED ON EXTERIOR OF BUILDING.
3. EACH METER MUST HAVE A PERMANENT LABEL DESIGNATING UNIT BEFORE METER CAN BE INSTALLED.
4. METER SOCKETS MUST BE RINGLESS.
5. METER SHALL NOT BE OBSTRUCTED AND A TEN FOOT CLEARANCE MUST BE MAINTAINED FOR SAFETY.

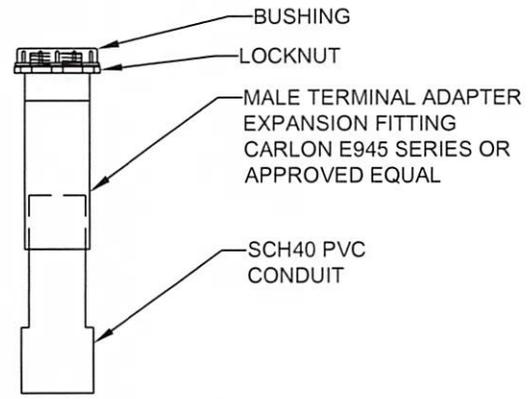

EXPANSION FITTING DETAIL
NOT TO SCALE

 Life. Made better.™	APPROVAL	REVISED	EASTON UTILITIES STANDARD DETAILS METER STACK DETAIL
	 EU ENGINEERING DEPARTMENT	MAR 2026	
	3/11/2026 DATE		
	ISSUED: MAY 2025		
		STANDARD NO.: E-107.3	