


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\GS-100.1.dwg, 1/30/2024 10:16:33 AM, 1:1



NOTES:

1. GAS TRENCH WIDTH VARIES DEPENDING UPON PIPE SIZE.
2. PLASTIC MAINS SHALL HAVE A MINIMUM OF 36" OF COVER OR AS DIRECTED BY EASTON UTILITIES.
3. MINIMUM 18" CLEARANCE FROM OTHER UNDERGROUND UTILITIES.
4. TRENCH BACKFILL SHALL BE TAMPED IN 6" LIFTS TO ENSURE PROPER COMPACTION.
5. STREET OPENINGS AND NON-PAVED AREAS SHALL BE RESTORED IN ACCORDANCE WITH TOWN OF EASTON STANDARD DETAILS.
6. TRENCH MATERIAL MAY BE RE-USED AS BACKFILL IF IT IS DEEMED CLEAN AND REUSABLE BY AN EASTON UTILITIES GAS DEPARTMENT REPRESENTATIVE.
7. TRACER WIRE MUST BE SURFACED INTO VALVE BOX OR RHINO INTERNAL TERMINAL STYLE TEST STATION EVERY 400' TO 500'.
8. REINFORCED COATED TRACER WIRE AS MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC, OR AN APPROVED EQUAL.
9. STANDARD MATERIALS REFER TO MARYLAND STATE HIGHWAY ADMINISTRATION STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MATERIALS.

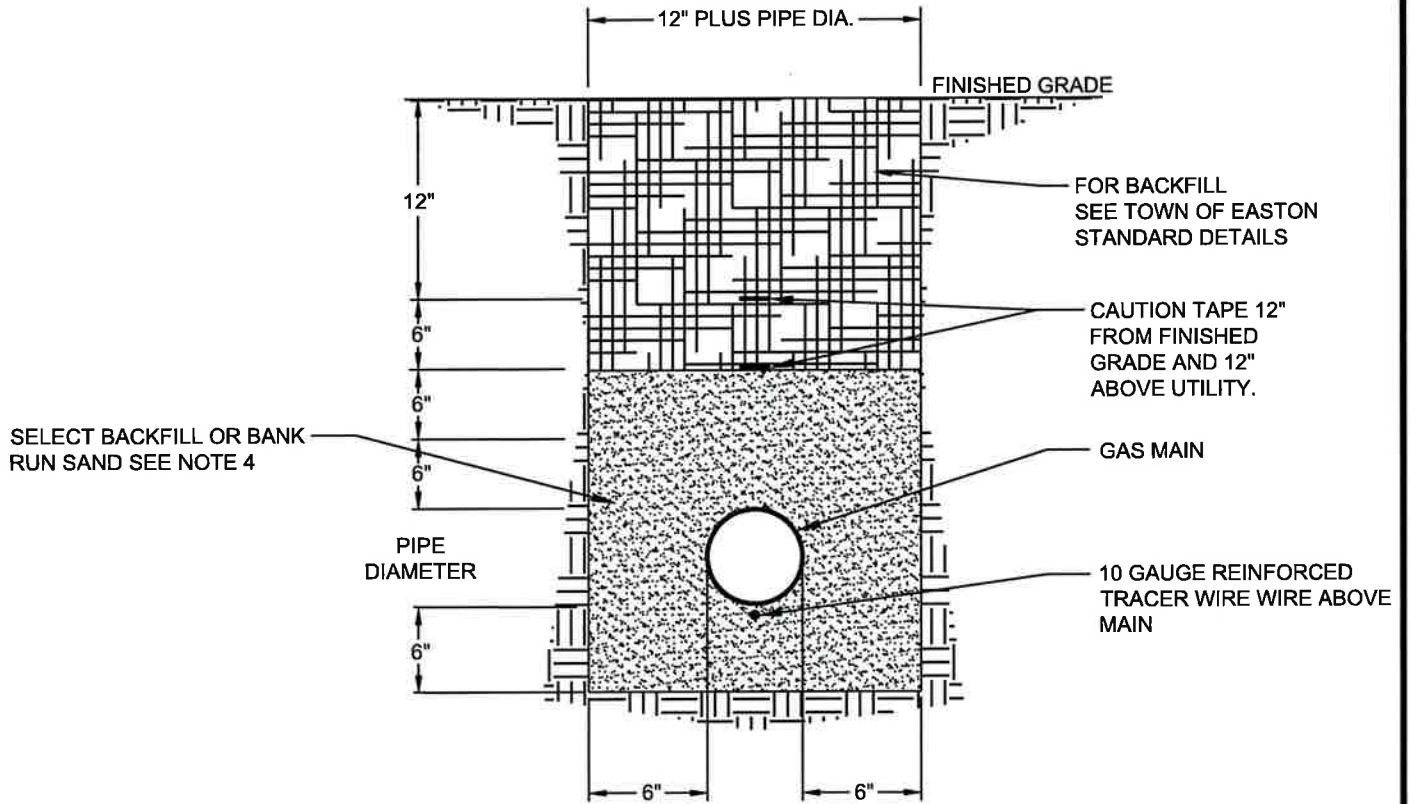

Life. Made better.™

APPROVAL	REVISED
 EU ENGINEERING DEPARTMENT	
1/31/2024 DATE	

**EASTON UTILITIES
STANDARD DETAILS**

GAS MAIN TRENCH

ISSUED: JANUARY 2024 **STANDARD NO.: GS-100.1**