




O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\GS-100.2.dwg, 1/30/2024 10:27:13 AM, 1:1

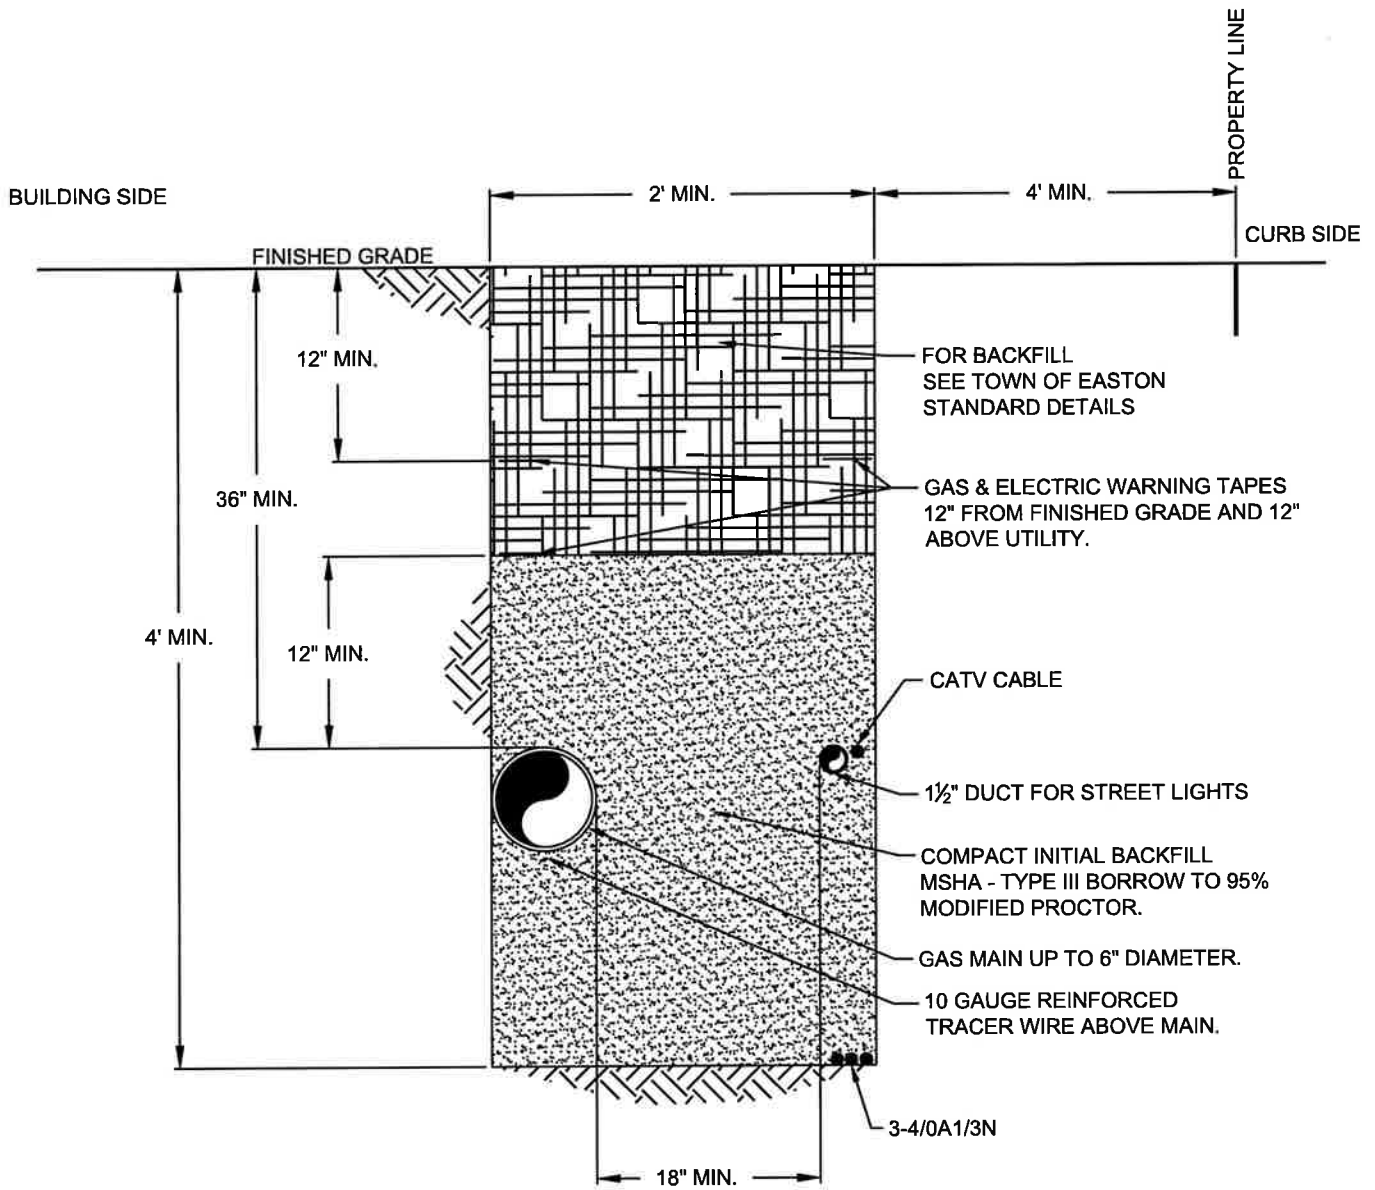

NOTES:

1. TRACER WIRE MUST BE SURFACED INTO VALVE BOX OR RHINO INTERNAL TERMINAL STYLE TEST STATION EVERY 400' TO 500'.
2. STREET OPENINGS AND NON-PAVED AREAS SHALL BE RESTORED IN ACCORDANCE WITH TOWN OF EASTON STANDARD DETAILS.
3. REINFORCED COATED TRACER WIRE AS MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC OR AN APPROVED EQUAL.

 Life. Made better.™	APPROVAL	REVISED	EASTON UTILITIES STANDARD DETAILS GAS JOINT TRENCH	
	 EU ENGINEERING DEPARTMENT			
	1/31/2024 DATE			
	ISSUED: JANUARY 2024			STANDARD NO.: GS-100.2