


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\SS-100.1.dwg, 1/31/2024 8:57:54 AM, 1:1





NOTES:

1. BEDDING, HAUNCHING AND FILL MATERIAL TO THE TOP OF PIPE SHALL BE COARSE AGGREGATE MEETING THE REQUIREMENTS OF AASHTO M43, SIZE NUMBER 57.
2. DURING HAUNCHING, CONTRACTOR SHALL CAREFULLY WORK GRAVEL DOWN AROUND THE BOTTOM OF THE PIPE.
3. WARNING TAPE SHALL BE PLACED 12" ABOVE PIPE AND 12" BELOW GRADE SURFACE.
4. CONTRACTOR TO PLACE FILL IN LIFTS, TAMPING AFTER EACH LIFT. LIFTS NOT TO EXCEED 6".
5. THOROUGHLY TAPE MECHANICAL CONNECTIONS OF TRACER WIRE WITH ELECTRICAL TAPE.
6. THE TRACING WIRE SHALL BE A CONTINUOUS CONDUCTOR CONNECTED TO ALL FITTINGS AND SERVICES.
7. ALL FITTINGS SHALL BE AS SPECIFIED IN AWWA C110-93, RESTRAINED MECHANICAL JOINT, DUCTILE IRON, PRESSURE RATED AT 350 PSI.
8. ALL FITTINGS SHALL BE RESTRAINED BY THRUST BLOCKS ACCORDING TO W-101.1.

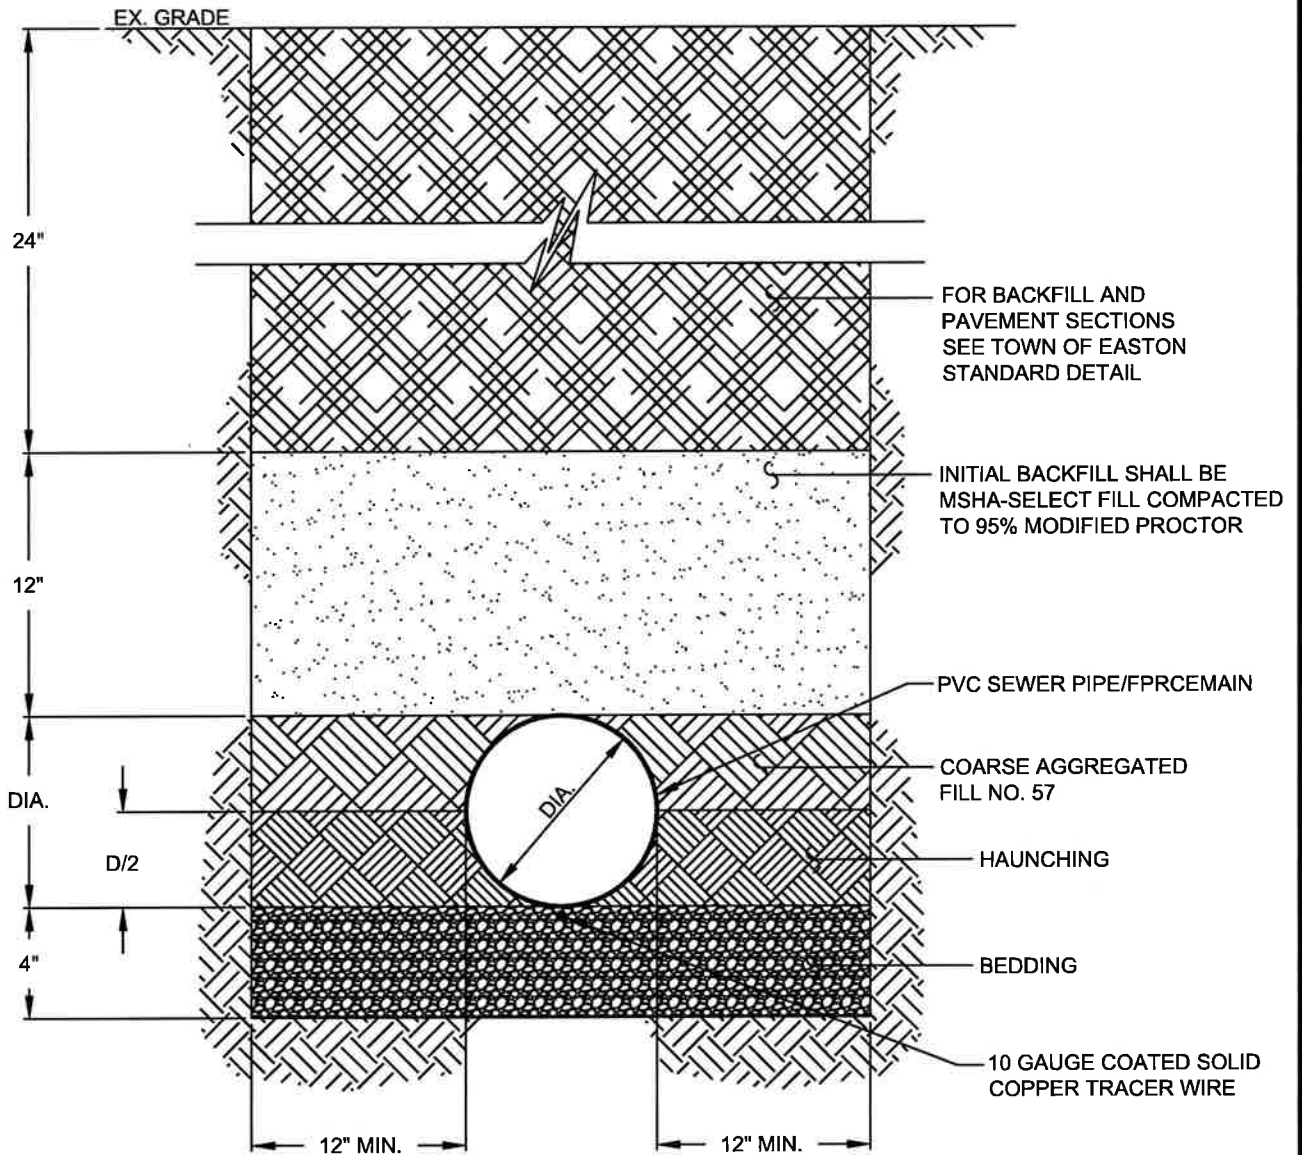

Life. Made better.™

	APPROVAL	REVISED	
	 EU ENGINEERING DEPARTMENT		EASTON UTILITIES STANDARD DETAILS
	 DATE		GRAVITY SEWER FORCEMAIN TRENCH
	ISSUED: JANUARY 2024		STANDARD NO.: SS-100.1