



O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\SS-101.2.dwg, 1/31/2024 8:11:56 AM, 1:1

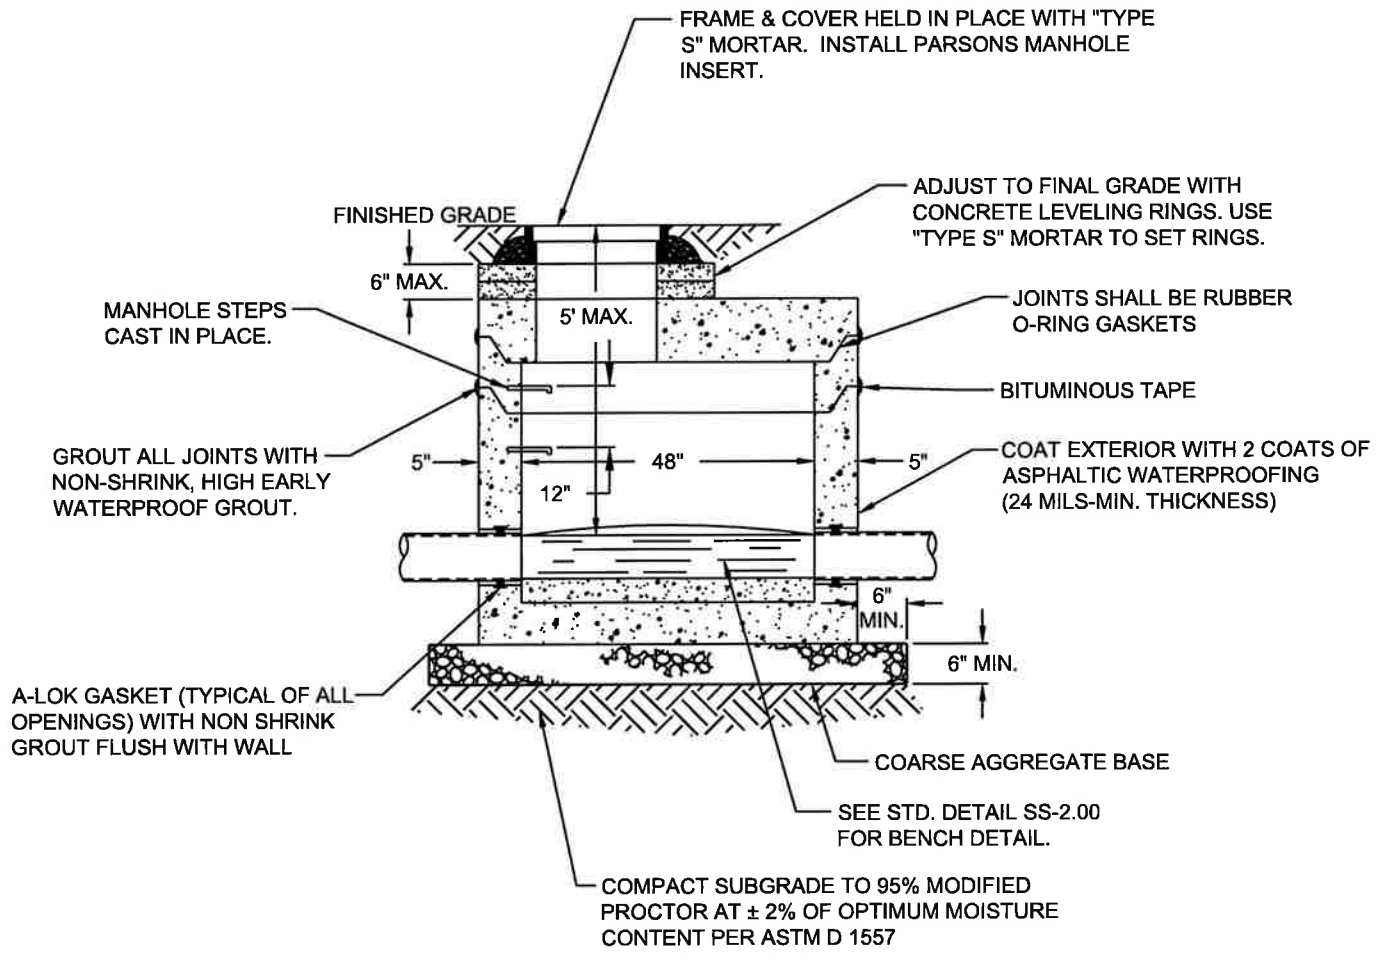

- NOTES:
1. PRECAST MANHOLE SHALL BE 4000 PSI REINFORCED CONCRETE THAT CONFORMS TO ASTM C-478 (LATEST) AS MANUFACTURED BY: GILLESPIE PRECAST OR AN APPROVED EQUAL.
 2. BENCH AND CHANNEL SHALL BE BRICK, PRECAST OR HAND FORMED CONCRETE. ELEVATION DROP ACROSS MANHOLE SHALL BE A MINIMUM OF 0.1' FROM INVERT IN TO INVERT OUT.
 3. MANHOLE STEPS, FRAME AND COVER REQUIRED OVER EFFLUENT SIDE AS SHOWN.

 Life. Made better.™	APPROVAL	REVISED	EASTON UTILITIES STANDARD DETAILS SHALLOW PRECAST MANHOLE	
	 EU ENGINEERING DEPARTMENT			
	1/31/2024 DATE			
	ISSUED: JANUARY 2024			
				STANDARD NO.: SS-101.2