




O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\SS-101.3.dwg, 1/31/2024 8:17:11 AM, 1:1

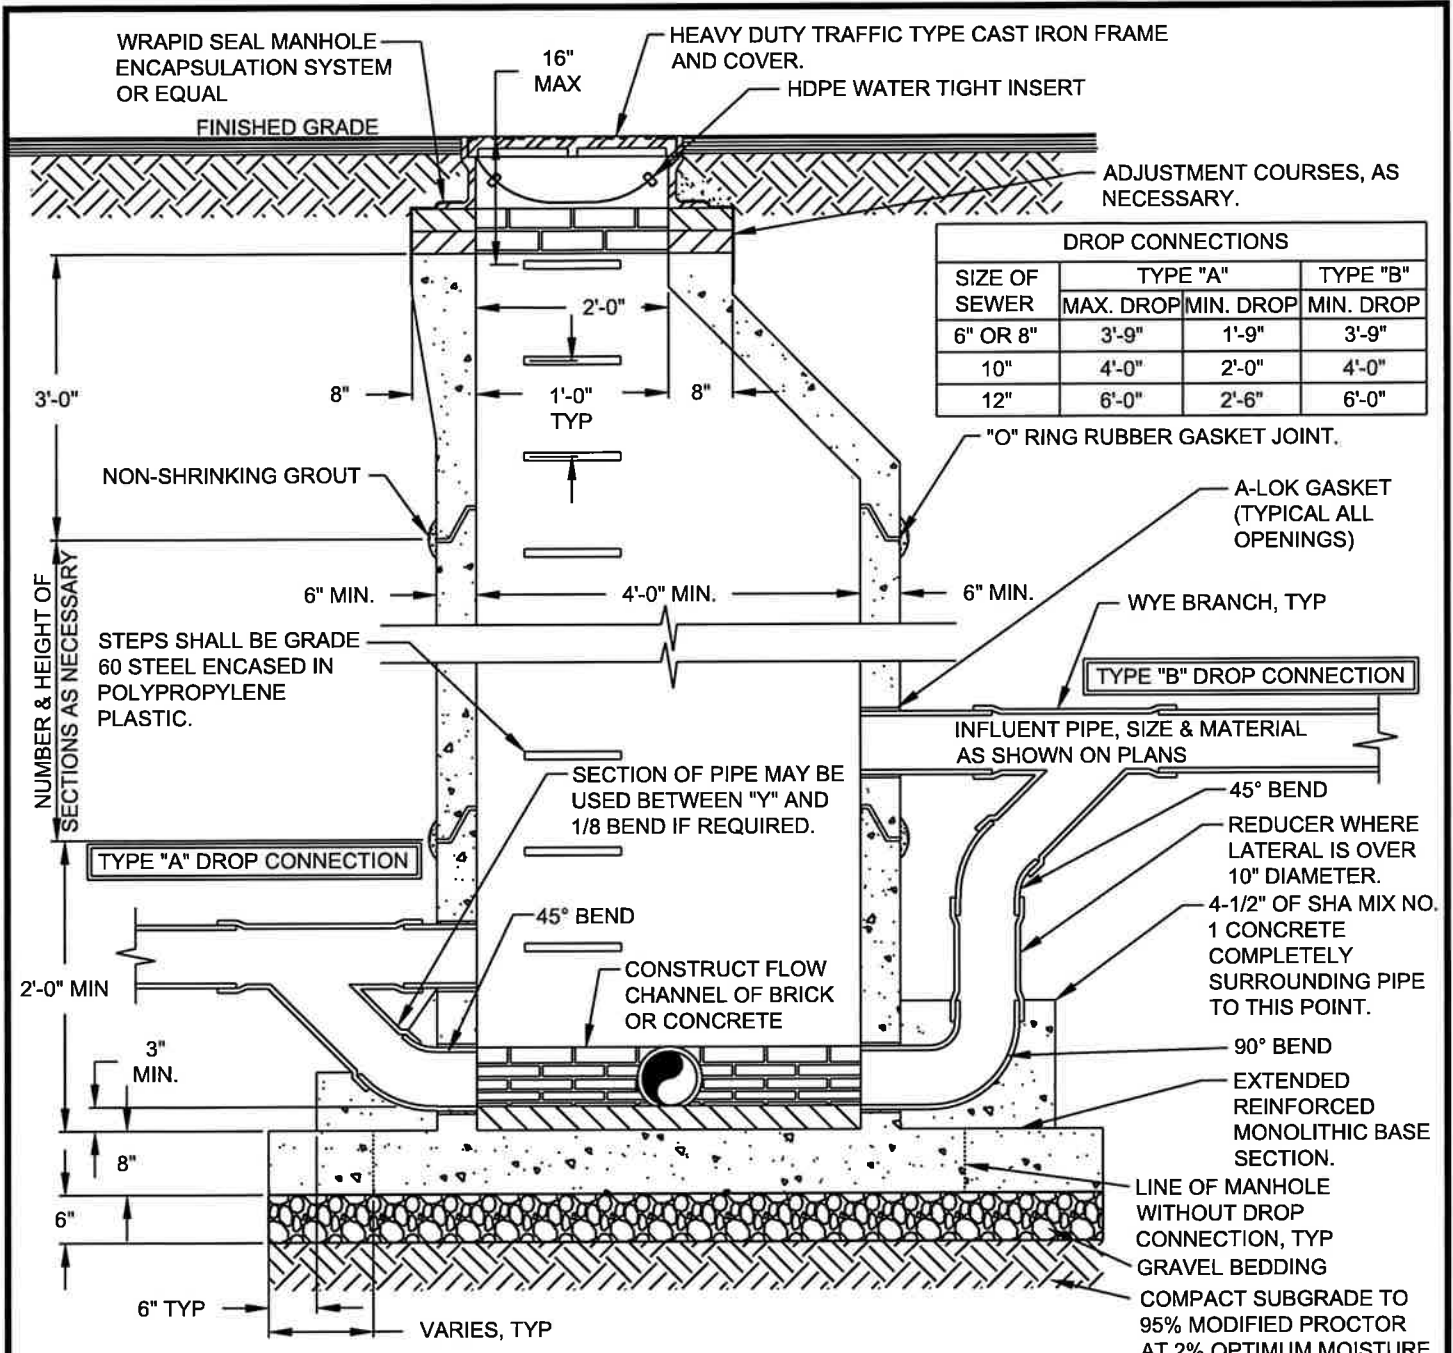

- NOTES:**
- STRUCTURE TO BE PRECAST AND CONFORM TO ASTM C-478 AND AASHTO M199, CONTRACTOR TO SUBMIT SHOP DRAWINGS TO ENGINEER FOR APPROVAL.
  - INSTALL FRAME AND COVER AT PROPOSED FINISHED GRADE, AS DIRECTED, UTILIZING PRECAST ADJUSTMENT COURSES, AS NECESSARY. MINIMUM ONE LAYER OF 3" OF CONCRETE WITH A MAXIMUM 12" STACKING HEIGHT.
  - PIPE OPENINGS SHALL BE AS NECESSARY FOR SIZE, LOCATION AND INVERTS PROVIDED ON THE SITE PLANS.
  - EXTERIOR TO BE COATED WITH TWO (2) COATS OF WATERPROOF BITUMASTIC COMPOUND (24 MILS MIN. THICKNESS).
  - MANHOLE DIAMETER MAY VARY DEPENDING ON PIPE SIZES AND ANGLES OF DEFLECTION.

 <b>Life. Made better.™</b>	<b>APPROVAL</b>	<b>REVISED</b>	<b>EASTON UTILITIES STANDARD DETAILS</b>  <b>OUTSIDE DROP MANHOLE</b>	
	 EU ENGINEERING DEPARTMENT			
	1/31/2024 DATE			
	ISSUED: <b>JANUARY 2024</b>			
				STANDARD NO.: <b>SS-101.3</b>