


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\SS-103.3.dwg, 1/31/2024 9:18:58 AM, 1:1

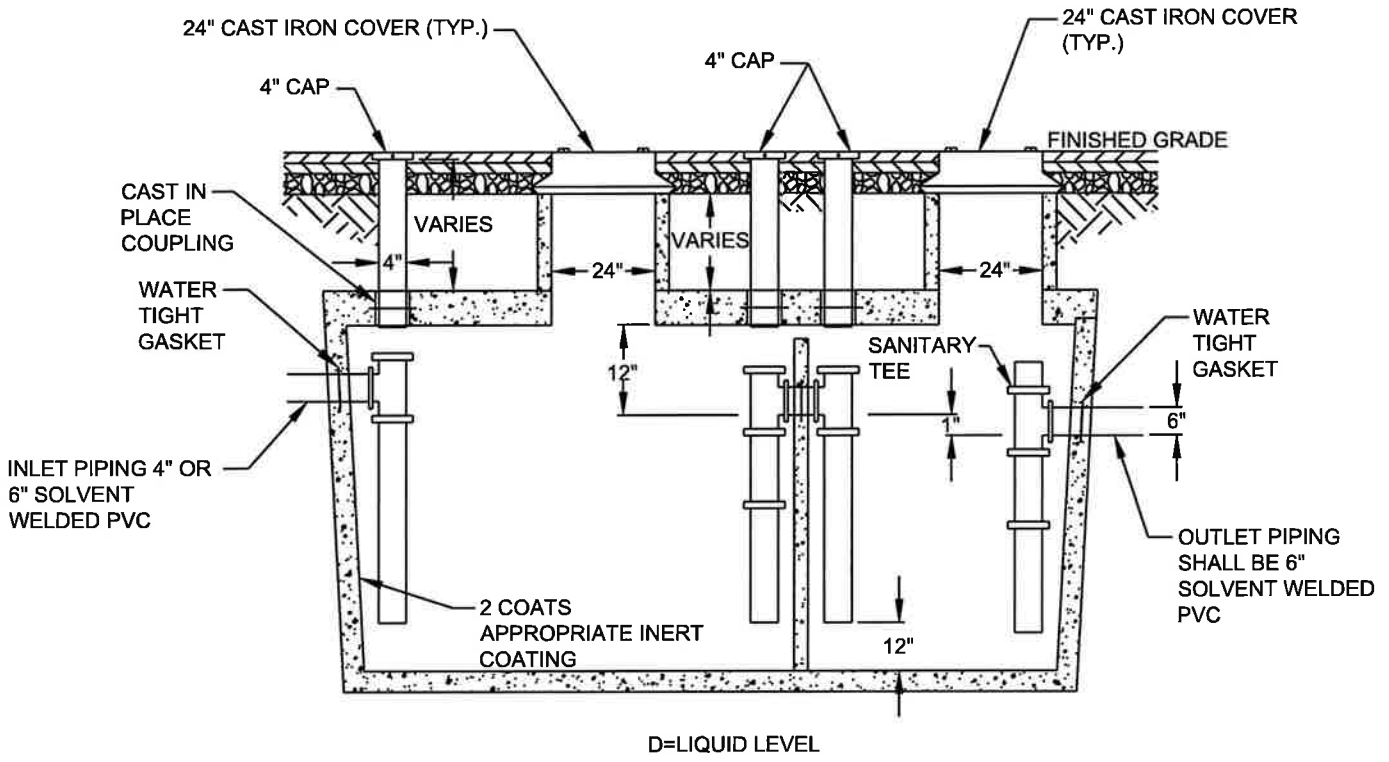

1500 GALLON (2 COMPARTMENT) TANK
NOT TO SCALE

NOTES

1. INTERCEPTORS ARE TO BE SIZED AND INSTALLED PER THE REQUIREMENTS OF EASTON UTILITIES.
2. ALL INLET AND OUTLET PIPES SHALL BE INSTALLED NO MORE THAN 12" FROM THE BOTTOM OF THE GREASE TRAP.
3. TANK TAPERS TOP TO BOTTOM AND IS TRAPEZOIDAL IN CROSS SECTION.
4. ALL GREASE INTERCEPTORS SHALL BE 4000 PSI CONCRETE-STEEL REINFORCED. CONCRETE CONFORMS TO ACI 318-16-4.5.1 AND 318-16-5.4.2.
5. WHEN LOCATED IN DRIVEWAYS OR PAVED AREAS, GREASE TRAP TO BE DESIGNED FOR APPROPRIATE LOAD BEARING CONDITIONS.
6. FILL VAULT WITH CLEAN WATER PRIOR TO START UP.
7. INTERCEPTOR SHALL BE CLEANED WHEN 25% OF ANY COMPARTMENT BECOMES FILLED WITH GREASE AND SOLIDS.
8. ALL GREASE CAPTURING DEVICES SHALL BE SUBMITTED TO THE EASTON UTILITIES ENGINEER FOR REVIEW.
9. GREY WATER ONLY. DOMESTIC SEWAGE SHALL BYPASS VAULT.

 Life. Made better.™	<p>APPROVAL</p>  EU ENGINEERING DEPARTMENT	<p>REVISED</p>	<p>EASTON UTILITIES STANDARD DETAILS</p> <p>GREASE INTERCEPTOR</p>
	<p>1/31/2024</p> <p>DATE</p>		
	<p>ISSUED: JANUARY 2024</p>		
	<p>STANDARD NO.: SS-103.3</p>		