




O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\SS-104.1.dwg, 1/31/2024 10:04:26 AM, 1:1

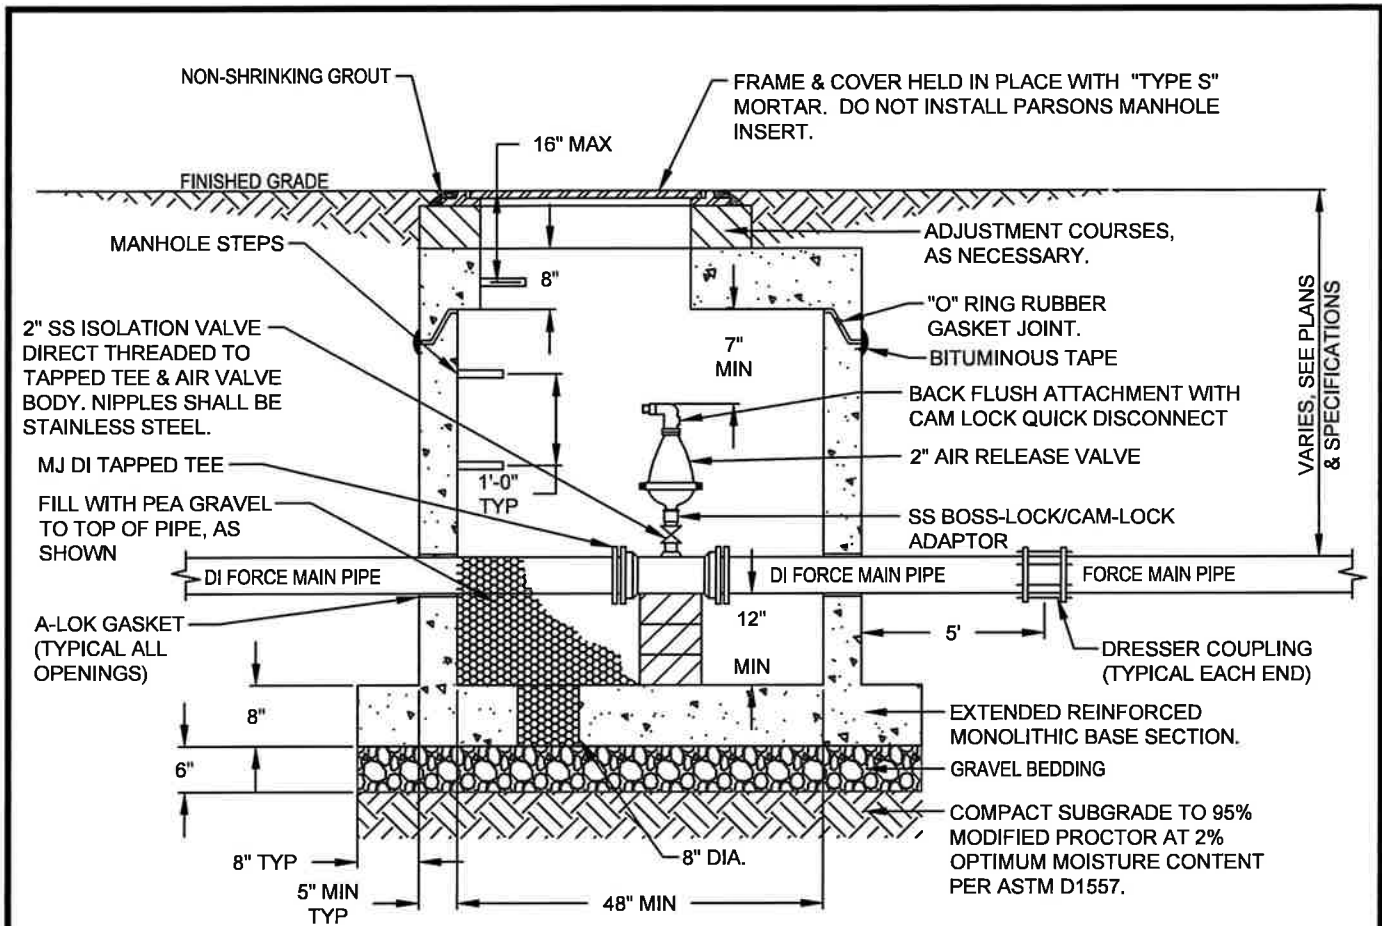

NOTES:

1. STRUCTURE TO BE 4000PSI REINFORCED CONCRETE THAT CONFORMS TO ASTM C-478 AND AASHTO M199, CONTRACTOR TO SUBMIT SHOP DRAWINGS TO ENGINEER FOR APPROVAL.
2. INSTALL FRAME AND COVER AT PROPOSED FINISHED GRADE, AS DIRECTED, UTILIZING BRICK OR PRECAST ADJUSTMENT COURSES, AS NECESSARY. MINIMUM ONE LAYER OF BRICK OR 3" OF CONCRETE WITH A MAXIMUM 6' STACKING HEIGHT.
3. PIPE OPENINGS SHALL BE AS NECESSARY FOR SIZE, LOCATION AND INVERTS PROVIDED ON THE SITE PLANS.
4. EXTERIOR TO BE COATED WITH TWO (2) COATS OF WATERPROOF BITUMASTIC COMPOUND (24 MILS MIN. THICKNESS).
5. FORCEMAIN PIPE SIZE AND MATERIAL AS INDICATED IN PLANS AND SPECIFICATIONS.
6. ALL MATERIALS TO BE STAINLESS STEEL UNLESS OTHERWISE NOTED. NO GALVANIZED FITTINGS TO BE IN MANHOLE.
7. PROVIDE 8" DIAMETER OPENING FOR FRENCH DRAIN, AS SHOWN. FRENCH DRAIN AND BOTTOM OF MANHOLE TO BE FILLED WITH PEA GRAVEL TO TOP OF FORCEMAIN.
8. FORCEMAIN TO BE SUPPORTED BY BLOCKING, AS SHOWN, UNDER AIR RELEASE VALVE.

 Life. Made better.™	APPROVAL	REVISED	EASTON UTILITIES STANDARD DETAILS AIR RELEASE VALVE ASSEMBLY IN PRECAST MANHOLE	
	 EU ENGINEERING DEPARTMENT			
	1/31/2024 DATE			
	ISSUED: JANUARY 2024			STANDARD NO.: SS-104.1