


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\W-100.1.dwg, 1/30/2024 10:47:57 AM, 1:1




NOTES:

1. WARNING TAPE SHALL BE PLACED 12" ABOVE PIPE AND 12" BELOW GRADE SURFACE.
2. THE TRACING WIRE SHALL BE A CONTINUOUS CONDUCTOR CONNECTED TO ALL FITTINGS, FIRE HYDRANTS AND SERVICES.
3. ALL FITTINGS SHALL BE AS SPECIFIED IN AWWA C110, MECHANICAL JOINT, DUCTILE IRON, PRESSURE RATED AT 350 PSI.
4. ALL FITTINGS SHALL BE RESTRAINED BY THRUST BLOCKS ACCORDING TO EUC STANDARD DETAILS.
5. FIRM BEARING SHALL BE PROVIDED FOR FULL LENGTH OF BARREL. EXCAVATE FOR BELL HOLES.
6. AFTER PIPE IS INSTALLED ON BEDDING, PLACE BACKFILL IN LIFTS TO SPRINGLINE, CROWN AND COVER, TAMPING AFTER EACH LIFT. LIFTS NOT TO EXCEED 6".
7. THOROUGHLY TAPE MECHANICAL CONNECTIONS OF TRACER WIRE WITH ELECTRICAL TAPE.

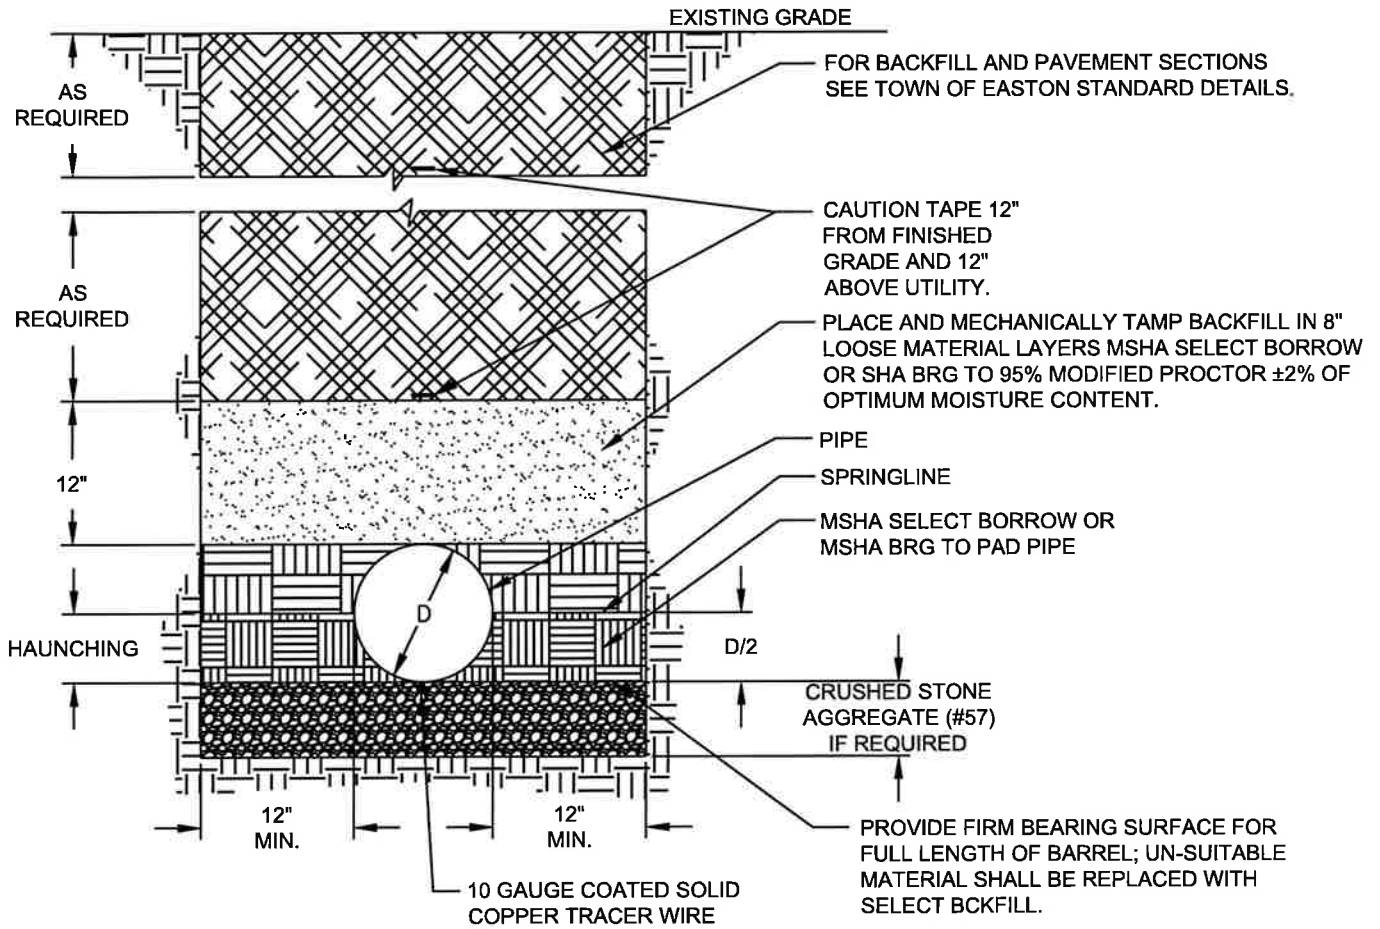

Life. Made better.™

	APPROVAL	REVISED	
	 EU ENGINEERING DEPARTMENT 1/31/2024 DATE		EASTON UTILITIES STANDARD DETAILS
			WATER MAIN INSTALLATION
	ISSUED: JANUARY 2024		STANDARD NO.: W-100.1