


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\W-100.3.dwg, 1/30/2024 1:42:03 PM, 1:1



NOTES:

1. BELL RESTRAINTS SHALL BE INSTALLED PER THE DESIGN ENGINEER'S RECOMMENDATION.
2. JOINT RESTRAINTS SHALL BE EPOXY COATED WITH STAINLESS STEEL HARDWARE.
3. JOINT RESTRAINTS SHALL BE MANUFACTURED BY EBAA OR APPROVED EQUAL.

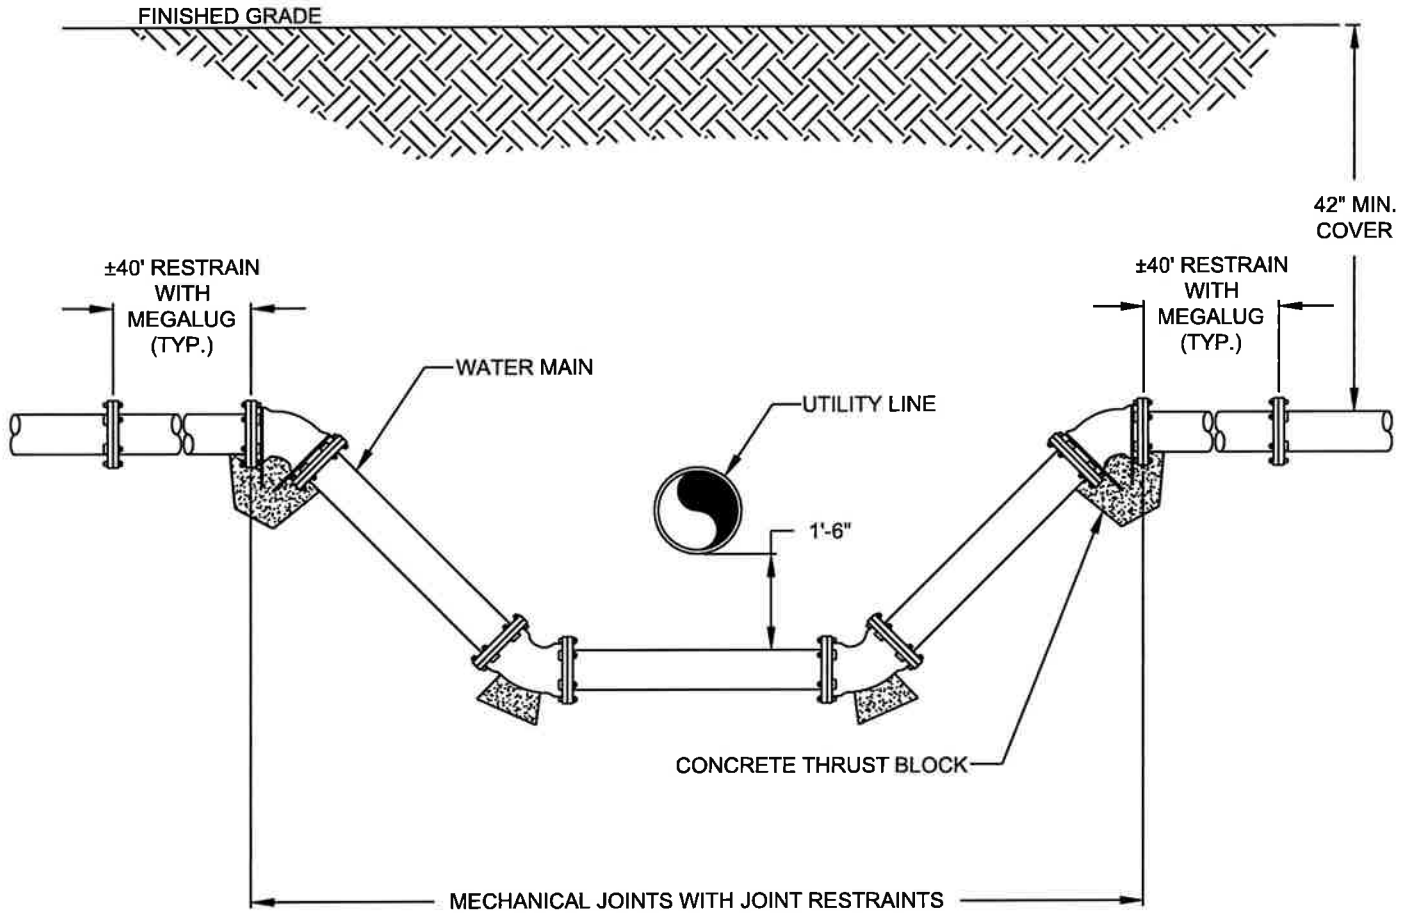

Life. Made better.™

APPROVAL

[Signature]

EU ENGINEERING DEPARTMENT

1/31/2024

DATE

REVISED

**EASTON UTILITIES
STANDARD DETAILS**

**WATER MAIN
DEFLECTION**

ISSUED: JANUARY 2024

STANDARD NO.: W-100.3