


O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\W-101.2.dwg, 1/30/2024 12:52:41 PM, 1:1



1. CONTRACTOR TO PROVIDE BLOCKING ADEQUATE TO WITHSTAND FULL TEST PRESSURE.
2. POUR CONCRETE BLOCKING AGAINST UNDISTURBED EARTH.
3. ALL CONCRETE SHALL BE SHA MIX #1.
4. WRAP PIPE AND/OR FITTINGS WITH 2 LAYERS OF POLYETHYLENE FILM WHERE IN CONTACT WITH CONCRETE.
5. KEEP CONCRETE CLEAR OF ALL JOINTS AND ACCESSORIES.
6. STIRRUPS SHALL BE STAINLESS STEEL STRAPS APPROVED BY EASTON UTILITIES ENGINEER.
7. CONTRACTOR MAY UTILIZE JOINT RESTRAINTS AND STAINLESS STEEL ALL THREADS IN PLACE OF VERTICAL BEND THRUST BLOCK WHEN APPROVED BY EASTON UTILITIES ENGINEER.
8. SAKRETE SHALL NOT BE PERMISSBLE.

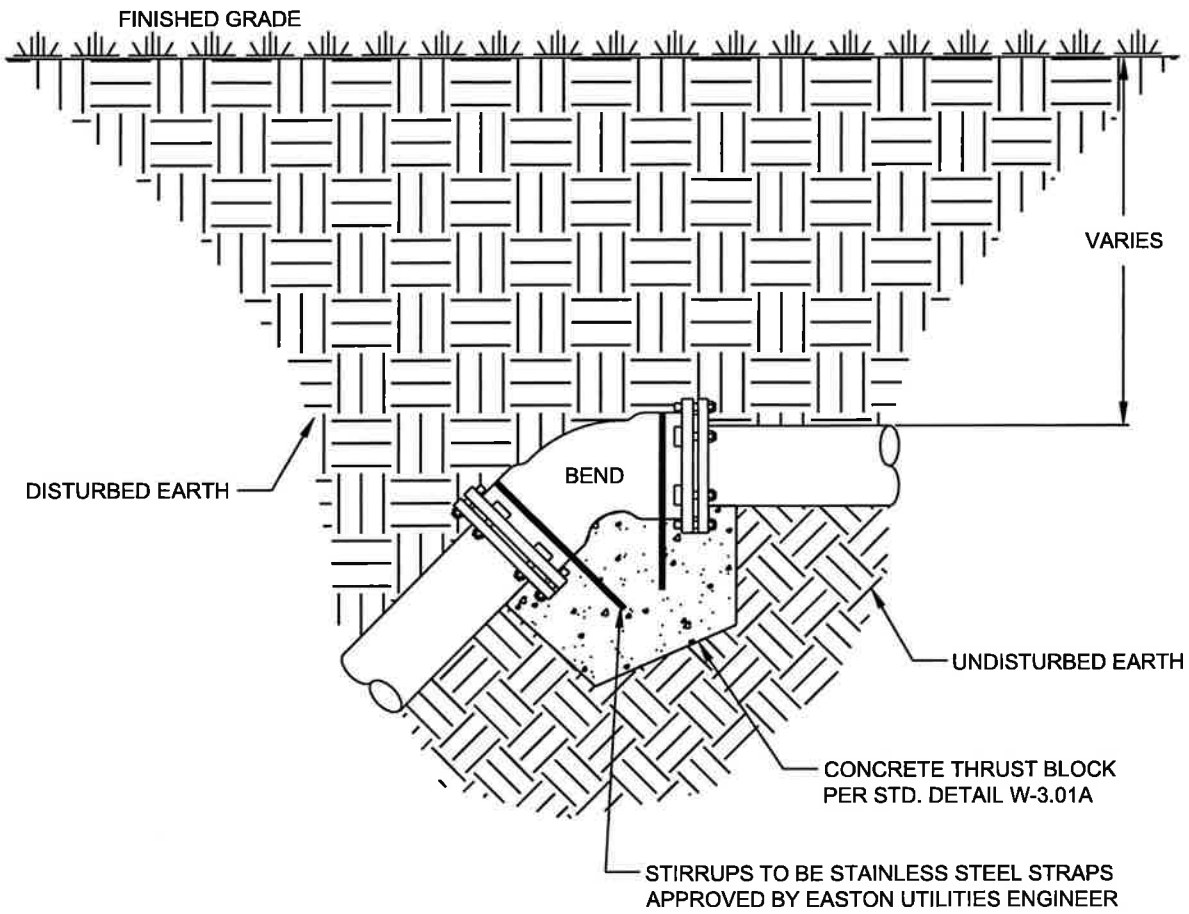

Life. Made better.™

	APPROVAL	REVISED	
	 EU ENGINEERING DEPARTMENT  1/31/2024 DATE		<b>EASTON UTILITIES STANDARD DETAILS</b>  <b>THRUST BLOCK VERTICAL BEND</b>
	<b>ISSUED: JANUARY 2024</b>		<b>STANDARD NO.: W-101.2</b>