


COVER

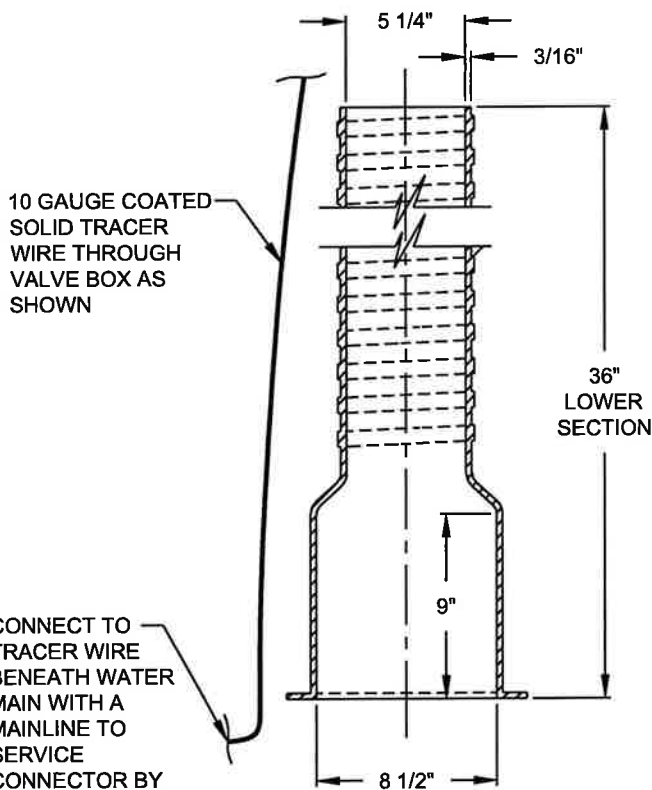

VALVE BOX SECTION

NOTES:

1. TO BE PLUMB AND CENTERED OVER VALVE.
2. ALL SECTIONS SHOWN TO BE GRAY IRON CASTINGS, CLASS NO. 35 ASTM A-48.
3. LOWER SECTION TO REST ON VALVE BONNET. VALVE BOX ALIGNMENT DEVICE BY TRUMBULL OR AN APPROVED EQUAL.
4. UPPER SECTION TO REST ON SELECT FILL COMPACTED TO 95% MODIFIED PROCTOR.
5. VALVE BOX TO BE #4905 MANUFACTURED BY BINGHAM & TAYLOR OR AN APPROVED EQUAL.
6. REINFORCED COATED TRACER WIRE AS MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC OR AN APPROVED EQUAL.
7. COVER TO BE MARKED FOR OTHER UTILITIES (SEWER, GAS, ETC.)

O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\W-102.3.dwg, 1/30/2024 1:10:38 PM, 1:1

CONNECT TO TRACER WIRE BENEATH WATER MAIN WITH A MAINLINE TO SERVICE CONNECTOR BY COPPERLAND INDUSTRY OR APPROVED EQUAL.



Life. Made better.™

APPROVAL

[Signature]
EU ENGINEERING DEPARTMENT

1/31/2024
DATE

REVISED

**EASTON UTILITIES
STANDARD DETAILS**

**SCREW TYPE
VALVE BOX**

ISSUED: JANUARY 2024

STANDARD NO.: W-102.3