




O:\standets\REVISED 2024\REVISED-RENUMBERED 2024\W-102.4.dwg, 1/30/2024 1:32:08 PM, 1:1

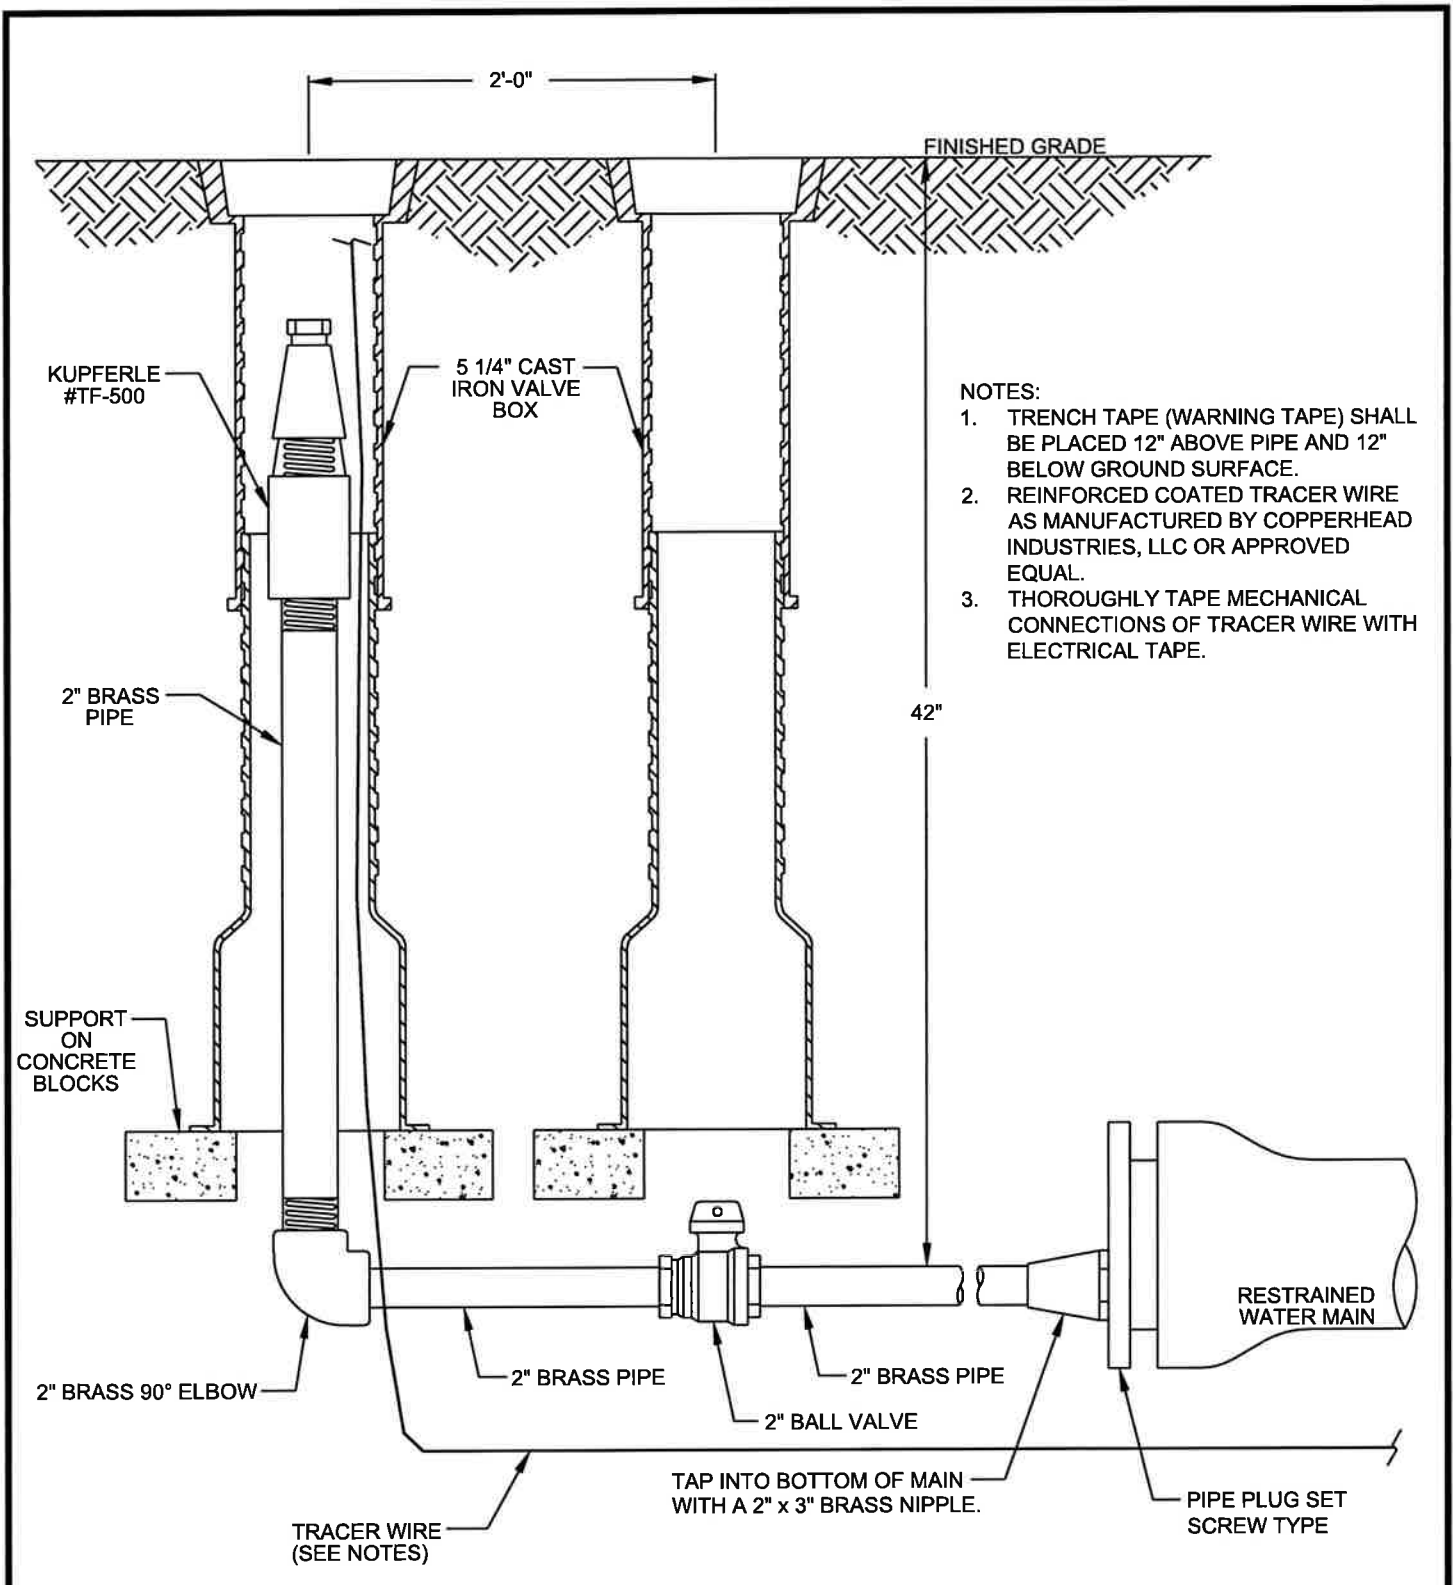

- NOTES:**
1. TRENCH TAPE (WARNING TAPE) SHALL BE PLACED 12" ABOVE PIPE AND 12" BELOW GROUND SURFACE.
 2. REINFORCED COATED TRACER WIRE AS MANUFACTURED BY COPPERHEAD INDUSTRIES, LLC OR APPROVED EQUAL.
 3. THOROUGHLY TAPE MECHANICAL CONNECTIONS OF TRACER WIRE WITH ELECTRICAL TAPE.

 Life. Made better.™	APPROVAL	REVISED	EASTON UTILITIES STANDARD DETAILS BLOW OFF SAMPLING STATION	
	 EU ENGINEERING DEPARTMENT			
	1/31/2024 DATE			
	ISSUED: JANUARY 2024			STANDARD NO.: W-102.4